


TERMINAL BOARD INSTRUMENT KONTAX KFC

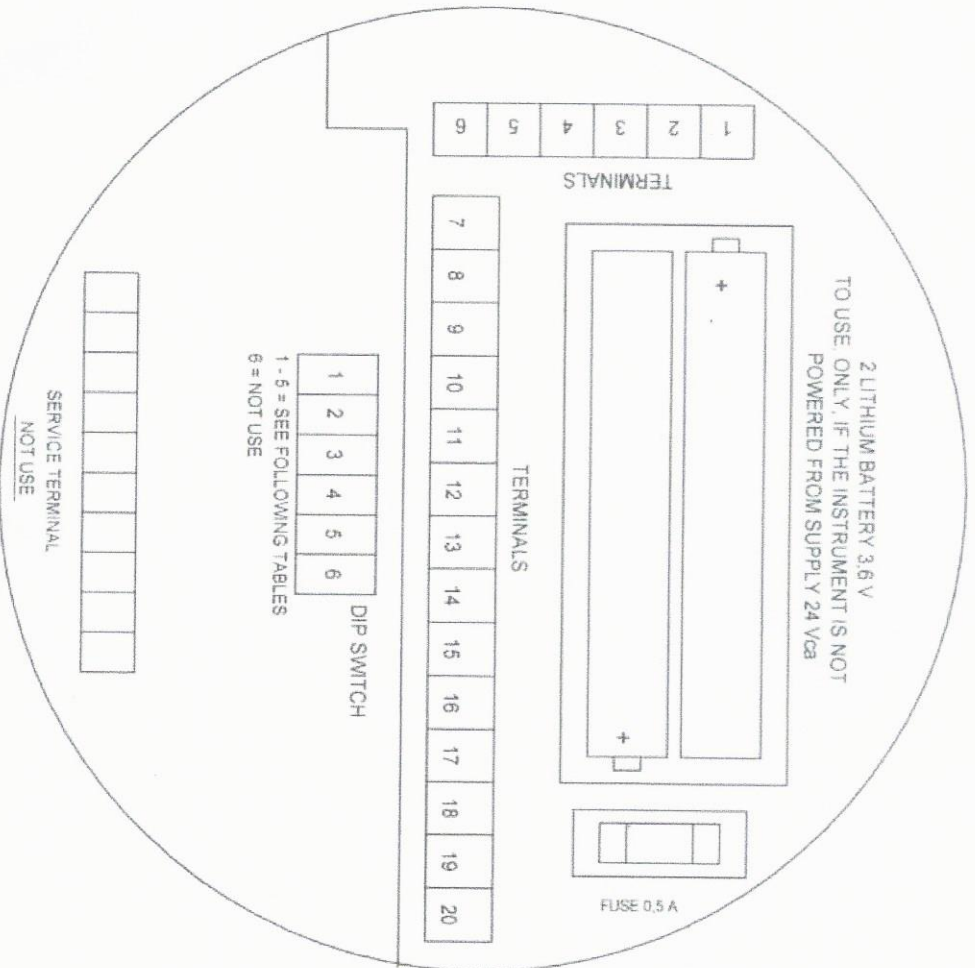

TERMINAL BOARD

THE TERMINALS NO VISIBLE HERE BELOVE THERE ARENT UTILIZED

- 1 = + (POSITIVE) 24 Vdc 100 mA ONLY ACTIVE SENSORS
- 2 = - (NEGATIVE 24 Vdc - GND)
- 3 = SCALED PULSE OUTPUT (MOSFET)
- 4 = SCALED PULSE OUTPUT (GND)
- 5 = SENSOR INPUT (PULSE FROM FLOWMETER)
- 6 = SENSOR INPUT (PULSE FROM FLOWMETER) - GND
- 7 = ANALOG OUTPUT 4 - 20 mA (MOSFET)
- 10 = COMMON OUTPUT (GND)
- 11 = MIN. FLOW RATE ALARM OUTPUT (MOSFET)
- 12 = MAX. FLOW RATE ALARM OUTPUT (MOSFET)

EXAMPLE OF WIRING KONTAX KFC

